


BILL OF MATERIAL						
Description	Inner Dia	Outer Dia	Length	Width	Thickness	Area of cross section (Nos)
PVC Insulated copper flexible cable	-	-	12000 mm	-	-	25 sq mm
G-Clamp Top	As per drawing					
G-Clamp Bottom	As per drawing					
FPP Round Tube Bottom	As per drawing					
FPP Round Tube Middle	As per drawing					
FPP Round Tube Top	As per drawing					
FPP Round Tube for holding Clamp	As per drawing					
Rubber Grip	As per drawing					

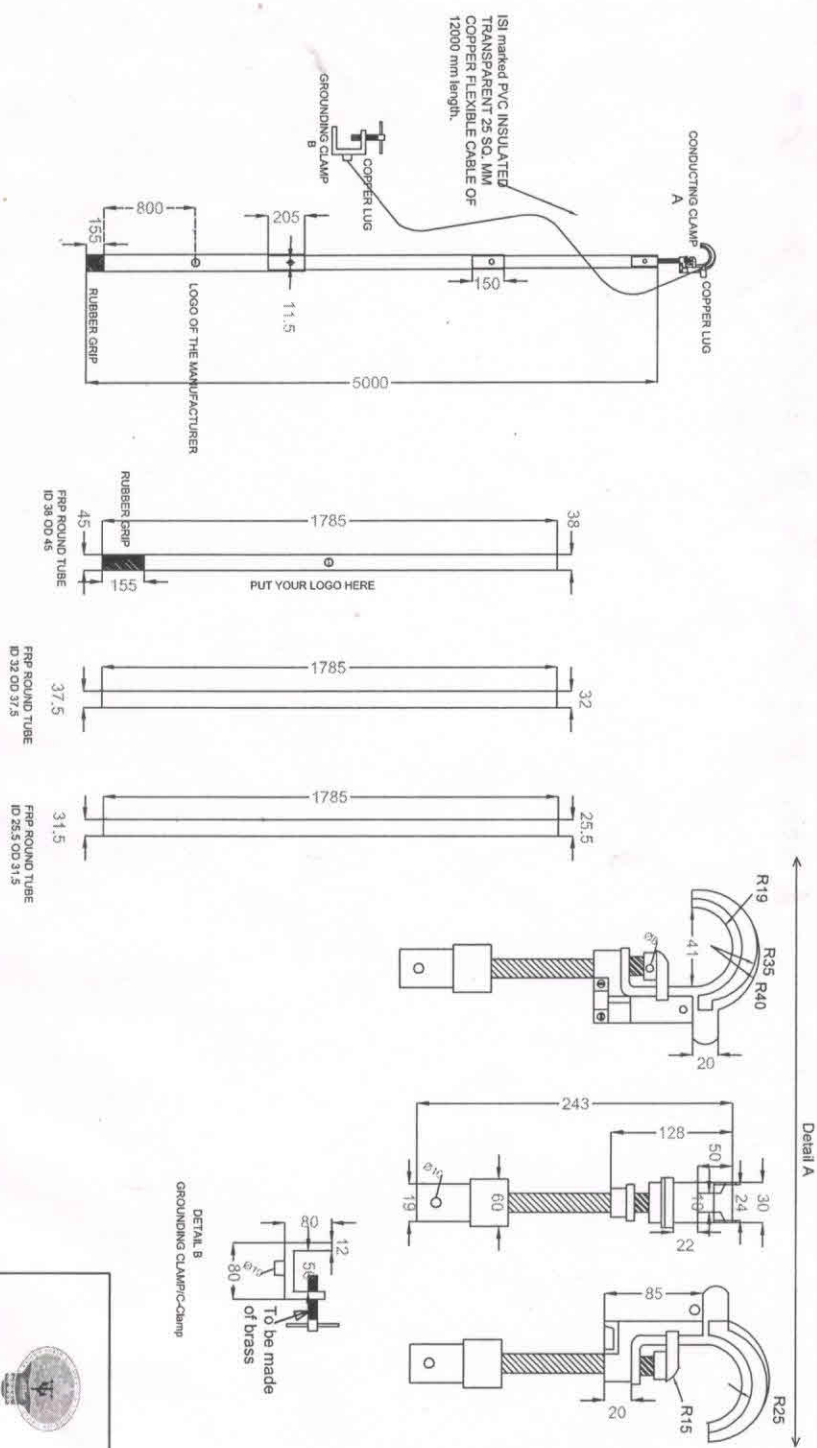

- Note:
1. All dimensions are in mm unless otherwise specified.
  2. Tender drawings subject to modification by the owner as per field requirement. Contractor to submit his drawings after the award of contract for approval of the owner

	<b>P&amp;P Wing, Kashmir Power Distribution Corporation Ltd.</b>		Name	Signature	Date
	DRAWN	Er. Aejaz (AEE)		26/11/22	
	CHECKED	Er. Manzoor (EE)		26/11/22	
	CHECKED	Er. Muzafar (SE)		26/11/22	
APPROVED	Er. Muzafar (CE)		26/11/22		
EARTHING /DISCHARGE ROD			Scale	NTS	Rev
Rev			01		
Drawing no	CE/P&P/Dwg./2022/FRPER001				
Date of issue	28-11-2022				